



LB
ALUMINIUM
BERHAD

198501006093 (138535-V)

PERFORMANCE LOUVRE SYSTEMS

Screening, Ventilation and Rain Defence



ALBESiana[®] PL-SB01



ALBESiana[®] PL-DB01



ALBESiana[®] PL-TB01



ALBESiana[®] PL-TB02

WWW.LBALUM.COM

Vol. August 2026

**TABLE OF CONTENTS****PAGE NUMBER****1) ALBESiana PERFORMANCE LOUVRE SYSTEMS**

a) Introduction of ABLESiana, Test Method & Classification	1/13
--	------

2) ALBESiana PL-SB01

a) Drawing of Assembly	2/13
b) Rainwater Penetration	3/13
c) Coefficient of Entry	3/13
d) Coefficient of Discharge	4/13

3) ALBESiana PL-DB01

a) Drawing of Assembly	5/13
b) Rainwater Penetration	6/13
c) Coefficient of Entry	6/13
d) Coefficient of Discharge	7/13

4) ALBESiana PL-TB01

a) Drawing of Assembly	8/13
b) Rainwater Penetration	9/13
c) Coefficient of Entry	9/13
d) Coefficient of Discharge	10/13

5) ALBESiana PL-TB02

a) Drawing of Assembly	11/13
b) Rainwater Penetration	12/13
c) Coefficient of Entry	12/13
d) Coefficient of Discharge	13/13



PERFORMANCE LOUVRES

By definition, a performance louvre system is a stack of specially designed louvre blades spaced out in such a way as to regulate air flow while restricting water leakage across the louvre panel.

APPLICATIONS

1. Building envelope over spaces
2. HVAC facility rooms (heating ventilation and air conditioning)
3. Electrical switch rooms
4. Plant rooms with special machineries
5. Warehouses and distribution centres
6. Staircase landing and protected walkway
7. Car parks

BS EN 13030

The BS EN 13030 standard sets the guidelines for testing and provides useful classifications for the water ingress levels and pressure drop coefficients of a louvre system. This is a well recognised industry standards for louvre system in Europe.

ALBESiana Performance louvres are fully tested at BSRIA to establish their performance levels.

PROPERTIES

- Fabricated from alloy 6063-T5 extruded aluminium profiles
- Require minimum maintenance
- Are available in anodised, powder-coated or PVDF finishes
- Are fully tested to the BS EN 13030 standard at BSRIA - The Building Services Research and Information Association, UK.

ALBESiana PERFORMANCE LOUVRES SYSTEMS

(a) *Single Bank Aluminium Louvre* :

Provides basic weather protection and ventilation, allowing airflow while reducing rain and debris entry.

(b) *Double Bank Aluminium Louvre* :

Offers improved rain defense and airflow control with staggered blades for enhanced weather protection.

(c) *Triple Bank Aluminium Louvre* :

Delivers maximum weather protection and significant airflow, ideal for harsh conditions with superior performance.

RAIN DEFENSE CLASSIFICATION

Class	Effectiveness	Max. allowed rain penetration l/h/m ²
A	99% to 100%	0.75
B	95% to 98.9%	3.75
C	80% to 94.9%	15
D	Below 80%	Greater than 15.00

Note : Water penetration effectiveness is measured for each of eight face velocities from 0 m/s to 3.5 m/s. Louvre penetration class should always be expressed in the context of the face velocity it was measured at.


AIR FLOW CLASSIFICATION

Class	Airflow Effectiveness	Performance Rating
1	0.4 to 1	Excellent
2	0.3 to 0.399	Very Good
3	0.2 to 0.299	Good
4	0.199 & below	Fair

Note : Discharge / entry loss coefficient is expressed as a single class, based on an average result over a range of face velocities. The higher the coefficient, the less resistant the louvre : allowing air to pass more freely.



TYPICAL ASSEMBLY SECTIONAL DETAILS

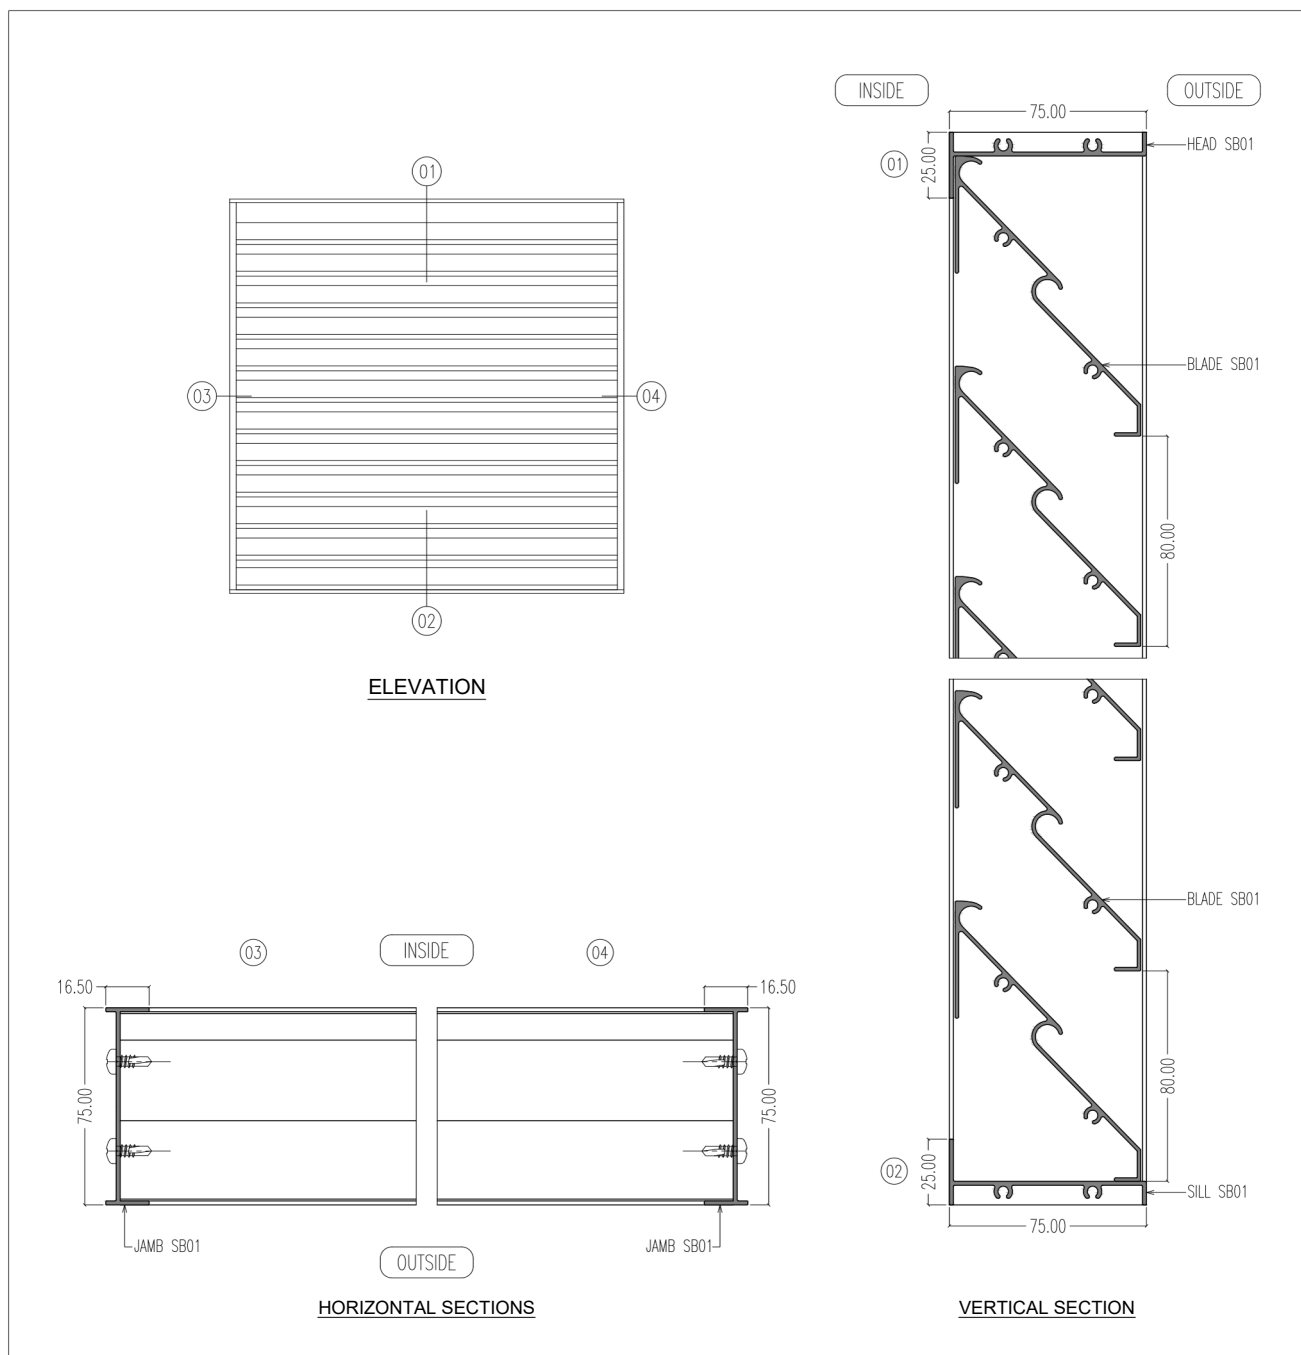



RAINWATER PENETRATION

Simulated Rainfall	75 (+10% / -0%)	mm/hr	Core Area Height	987	mm
Wind Speed	13 (+/-10%)	m/s	Core Area Width	969	mm
			Core Area Area	0.956	m ²

Ventilation Rate		Water Flow Rates		Effectiveness %	Class
Volume m ³ /s	Velocity m/s	Supply l/h	Penetrated l/h		
0.00	0.00	97.2	5.0	93.6	C
0.48	0.50	97.2	10.1	87.0	C
0.96	1.00	97.2	13.7	82.4	C
1.44	1.50	97.2	18.2	76.6	D
1.91	2.00	97.2	27.4	65.0	D
2.39	2.50	97.2	43.8	43.9	D
2.87	3.00	97.2	58.5	25.5	D
3.35	3.50	97.2	68.6	12.0	D

COEFFICIENT OF ENTRY

Air Temperature	17.9	°C	Core Area Height	987	mm
Barometer	979.5	mbar	Core Area Width	969	mm
Air Density	1.168	kg/m ³	Core Area Area	0.956	m ²

Louvre p.d. Pa	Louvre Face Velocity	Air Flow Rate		Coefficient C _e
	m/s	Test m ³ /s	Theoretical m ³ /s	
10.0	0.80	0.769	3.958	0.194
28.9	1.32	1.264	6.729	0.188
59.5	1.88	1.798	9.655	0.186
90.3	2.31	2.213	11.894	0.186
120.0	2.67	2.551	13.711	0.186
152.0	2.99	2.860	15.431	0.185
183.0	3.28	3.134	16.932	0.185
213.0	3.54	3.385	18.267	0.185
246.0	3.79	3.623	19.632	0.185
280.0	4.03	3.855	20.944	0.184
Mean C _e				0.186
Class				4




COEFFICIENT OF DISCHARGE

Air Temperature	18.5	°C	Core Area Height	987	mm
Barometer	980.0	mbar	Core Area Width	969	mm
Air Density	1.166	kg/m ³	Core Area Area	0.956	m ²

Louvre p.d. Pa	Louvre Face Velocity	Air Flow Rate		Coefficient C _d
	m/s	Test m ³ /s	Theoretical m ³ /s	
10.0	0.93	0.890	3.961	0.225
25.5	1.48	1.415	6.325	0.224
44.5	1.97	1.887	8.356	0.226
65.8	2.39	2.288	10.161	0.225
86.3	2.74	2.616	11.637	0.225
107.0	3.06	2.925	12.957	0.226
126.0	3.34	3.194	14.061	0.227
146.0	3.59	3.431	15.136	0.227
172.0	3.88	3.711	16.428	0.226
198.0	4.17	3.988	17.626	0.226
Mean C _d				0.226
Class				3



TYPICAL ASSEMBLY SECTIONAL DETAILS

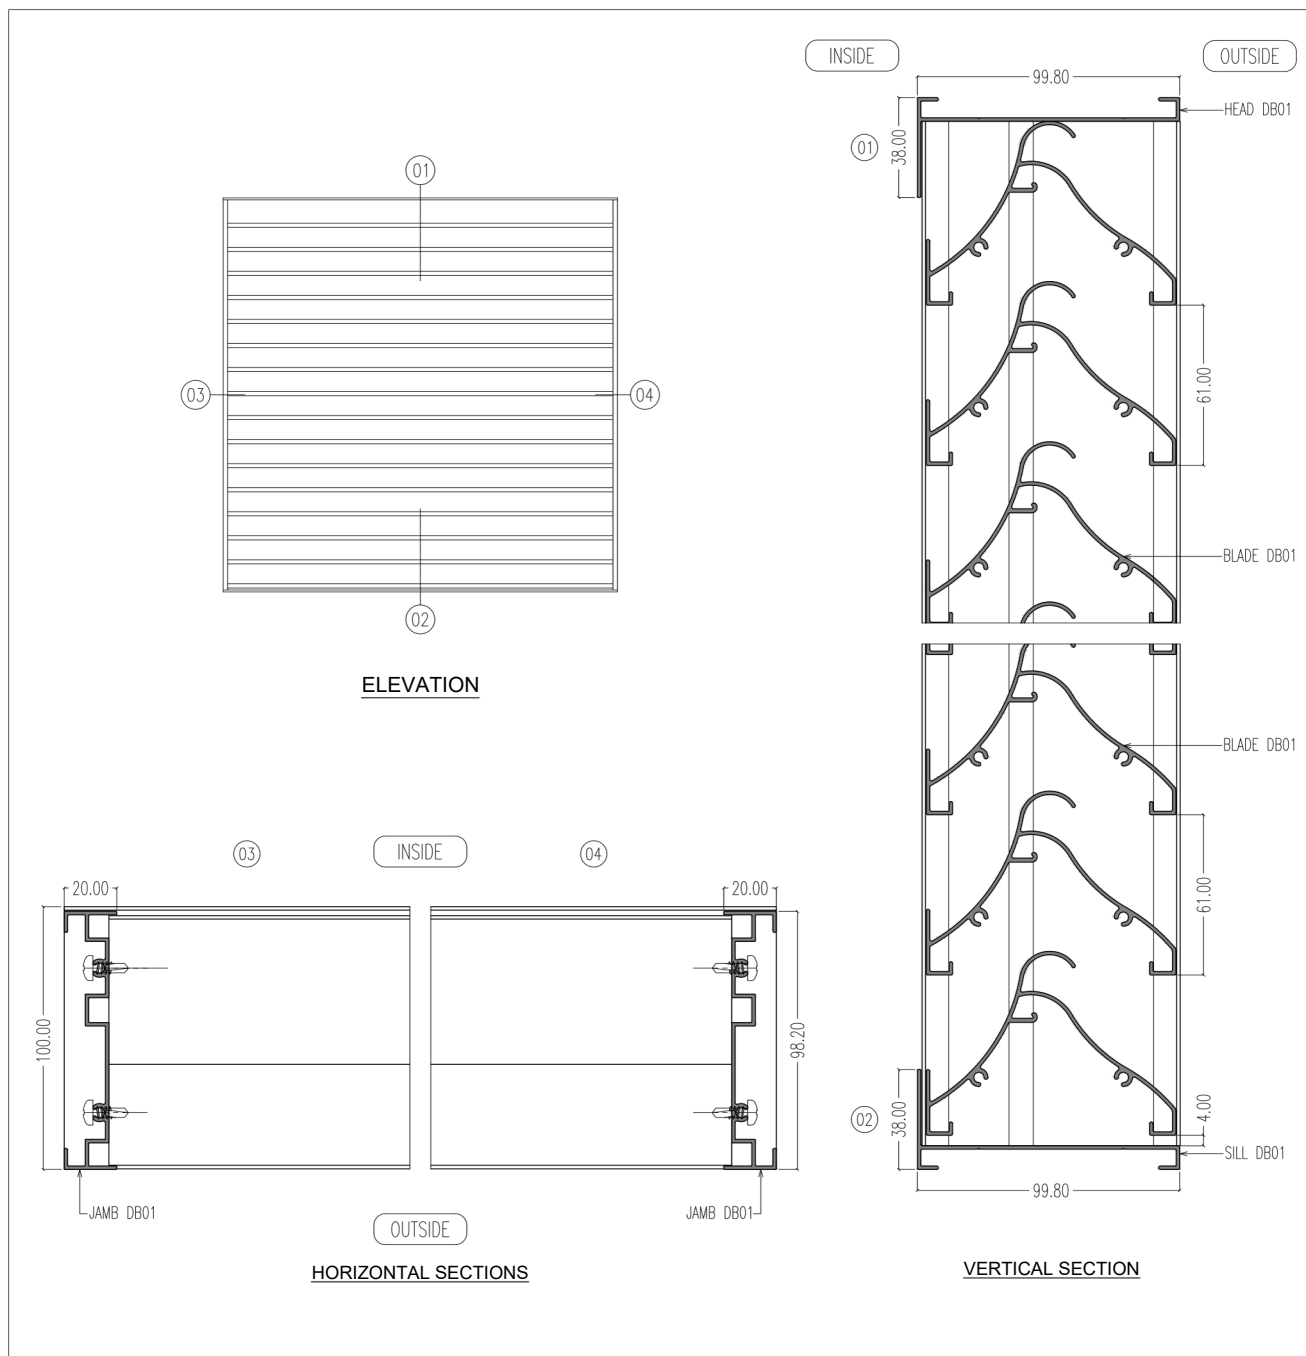



RAINWATER PENETRATION

Simulated Rainfall	75 (+10% / -0%)	mm/hr	Core Area Height	988	mm
Wind Speed	13 (+/-10%)	m/s	Core Area Width	958	mm
			Core Area Area	0.947	m ²

Ventilation Rate		Water Flow Rates		Effectiveness %	Class
Volume m ³ /s	Velocity m/s	Supply l/h	Penetrated l/h		
0.00	0.00	99.4	0.0	100.0	A
0.49	0.51	99.4	0.2	99.7	A
0.97	1.03	99.5	1.2	98.5	B
1.44	1.52	99.2	3.1	96.0	B
1.90	2.00	99.1	9.4	87.9	C
2.33	2.47	99.2	27.5	64.8	D
2.84	3.00	99.4	33.7	56.4	D
3.32	3.51	98.5	41.4	46.5	D

COEFFICIENT OF ENTRY

Air Temperature	12.4	°C	Core Area Height	988	mm
Barometer	1003.6	mbar	Core Area Width	958	mm
Air Density	1.220	kg/m ³	Core Area Area	0.947	m ²

Louvre p.d. Pa	Louvre Face Velocity	Air Flow Rate		Coefficient C _e
	m/s	Test m ³ /s	Theoretical m ³ /s	
35.3	1.32	1.247	7.201	0.173
67.8	1.83	1.730	9.980	0.173
100.0	2.23	2.106	12.120	0.174
135.0	2.56	2.425	14.083	0.172
166.0	2.86	2.707	15.616	0.173
200.0	3.13	2.962	17.141	0.173
228.0	3.37	3.192	18.301	0.174
266.0	3.60	3.405	19.768	0.172
300.0	3.81	3.607	20.993	0.172
330.0	4.01	3.797	22.018	0.172
Mean C _e				0.173
Class				4



COEFFICIENT OF DISCHARGE

Air Temperature 12.4 °C

Barometer 1003.6 mbar

Air Density 1.220 kg/m³

Core Area Height 988 mm





Core Area Width 958 mm

Core Area Area 0.947 m²

Louvre p.d. Pa	Louvre Face Velocity	Air Flow Rate		Coefficient C _d
	m/s	Test m ³ /s	Theoretical m ³ /s	
13.7	0.83	0.787	4.486	0.175
45.9	1.50	1.423	8.212	0.173
76.8	1.96	1.853	10.622	0.174
111.0	2.33	2.201	12.770	0.172
145.5	2.68	2.533	14.620	0.173
181.0	2.99	2.827	16.306	0.173
214.0	3.27	3.092	17.731	0.174
250.0	3.52	3.336	19.164	0.174
289.0	3.76	3.563	20.605	0.173
323.0	4.01	3.797	21.783	0.174
			Mean C _d	0.174
			Class	4



TYPICAL ASSEMBLY SECTIONAL DETAILS

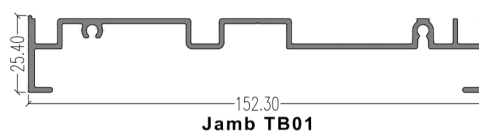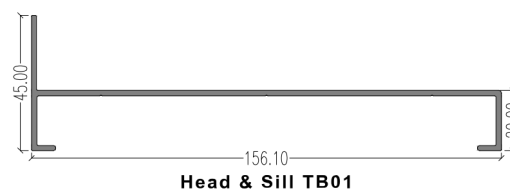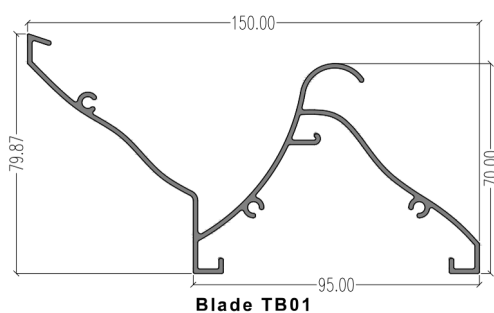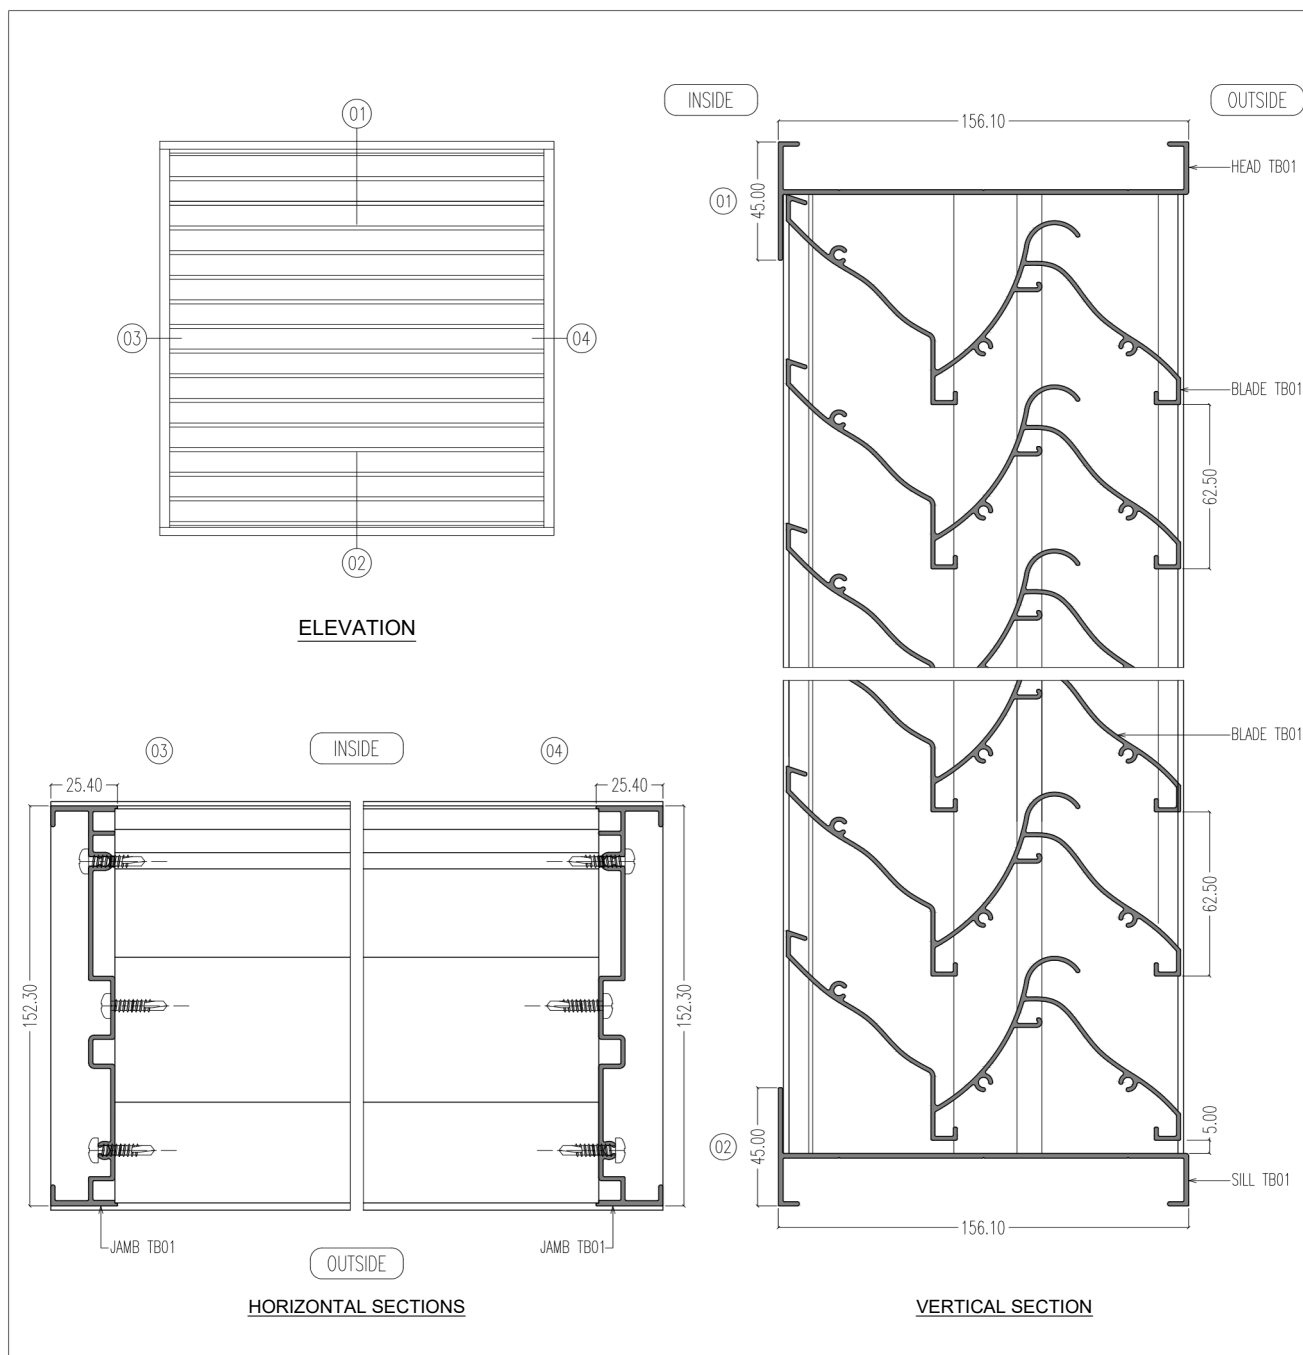



RAINWATER PENETRATION

Simulated Rainfall	75 (+10% / -0%)	mm/hr	Core Area Height	958	mm
Wind Speed	13 (+/-10%)	m/s	Core Area Width	949	mm
			Core Area Area	0.909	m ²

Ventilation Rate		Water Flow Rates		Effectiveness %	Class
Volume m ³ /s	Velocity m/s	Supply l/h	Penetrated l/h		
0.00	0.00	97.2	0.0	100.0	A
0.45	0.50	97.2	0.0	100.0	A
0.91	1.00	97.2	0.0	100.0	A
1.36	1.50	97.2	0.0	100.0	A
1.82	2.00	97.2	1.4	98.2	B
2.27	2.50	97.2	16.4	79.2	D
2.73	3.00	97.2	74.8	5.6	D
3.18	3.50	97.2	75.6	4.5	D

COEFFICIENT OF ENTRY

Air Temperature	25.8	°C	Core Area Height	958	mm
Barometer	1003.7	mbar	Core Area Width	949	mm
Air Density	1.165	kg/m ³	Core Area Area	0.909	m ²

Louvre p.d. Pa	Louvre Face Velocity	Air Flow Rate		Coefficient C _e
	m/s	Test m ³ /s	Theoretical m ³ /s	
11.1	0.63	0.571	3.969	0.144
56.8	1.42	1.291	8.978	0.144
103.0	1.90	1.727	12.090	0.143
146.0	2.27	2.062	14.394	0.143
192.0	2.60	2.359	16.506	0.143
237.0	2.88	2.617	18.339	0.143
286.0	3.15	2.864	20.146	0.142
346.0	3.46	3.143	22.158	0.142
402.0	3.73	3.389	23.884	0.142
458.0	3.99	3.628	25.493	0.142
Mean C _e				0.143
Class				4







COEFFICIENT OF DISCHARGE

Air Temperature	25.8	°C	Core Area Height	958	mm
Barometer	1003.2	mbar	Core Area Width	949	mm
Air Density	1.164	kg/m ³	Core Area Area	0.909	m ²

Louvre p.d. Pa	Louvre Face Velocity	Air Flow Rate		Coefficient C _d
	m/s	Test m ³ /s	Theoretical m ³ /s	
10.1	0.63	0.574	3.787	0.152
49.5	1.39	1.267	8.383	0.151
91.0	1.89	1.716	11.366	0.151
130.0	2.27	2.062	13.585	0.152
171.0	2.60	2.360	15.581	0.151
220.0	2.96	2.692	17.673	0.152
267.0	3.27	2.977	19.470	0.153
312.0	3.57	3.241	21.047	0.154
355.0	3.83	3.485	22.450	0.155
400.0	4.09	3.722	23.831	0.156
Mean C _d				0.153
Class				4



TYPICAL ASSEMBLY SECTIONAL DETAILS

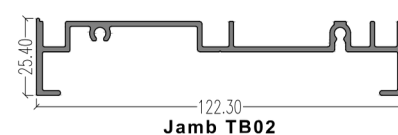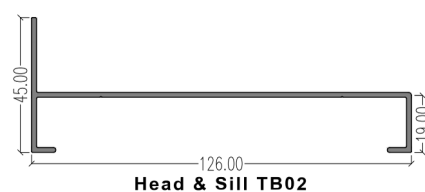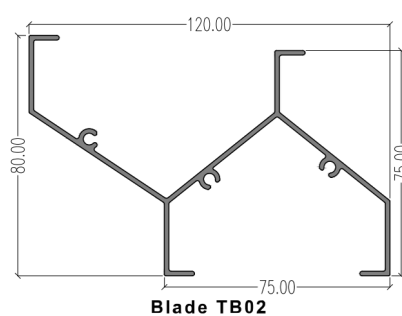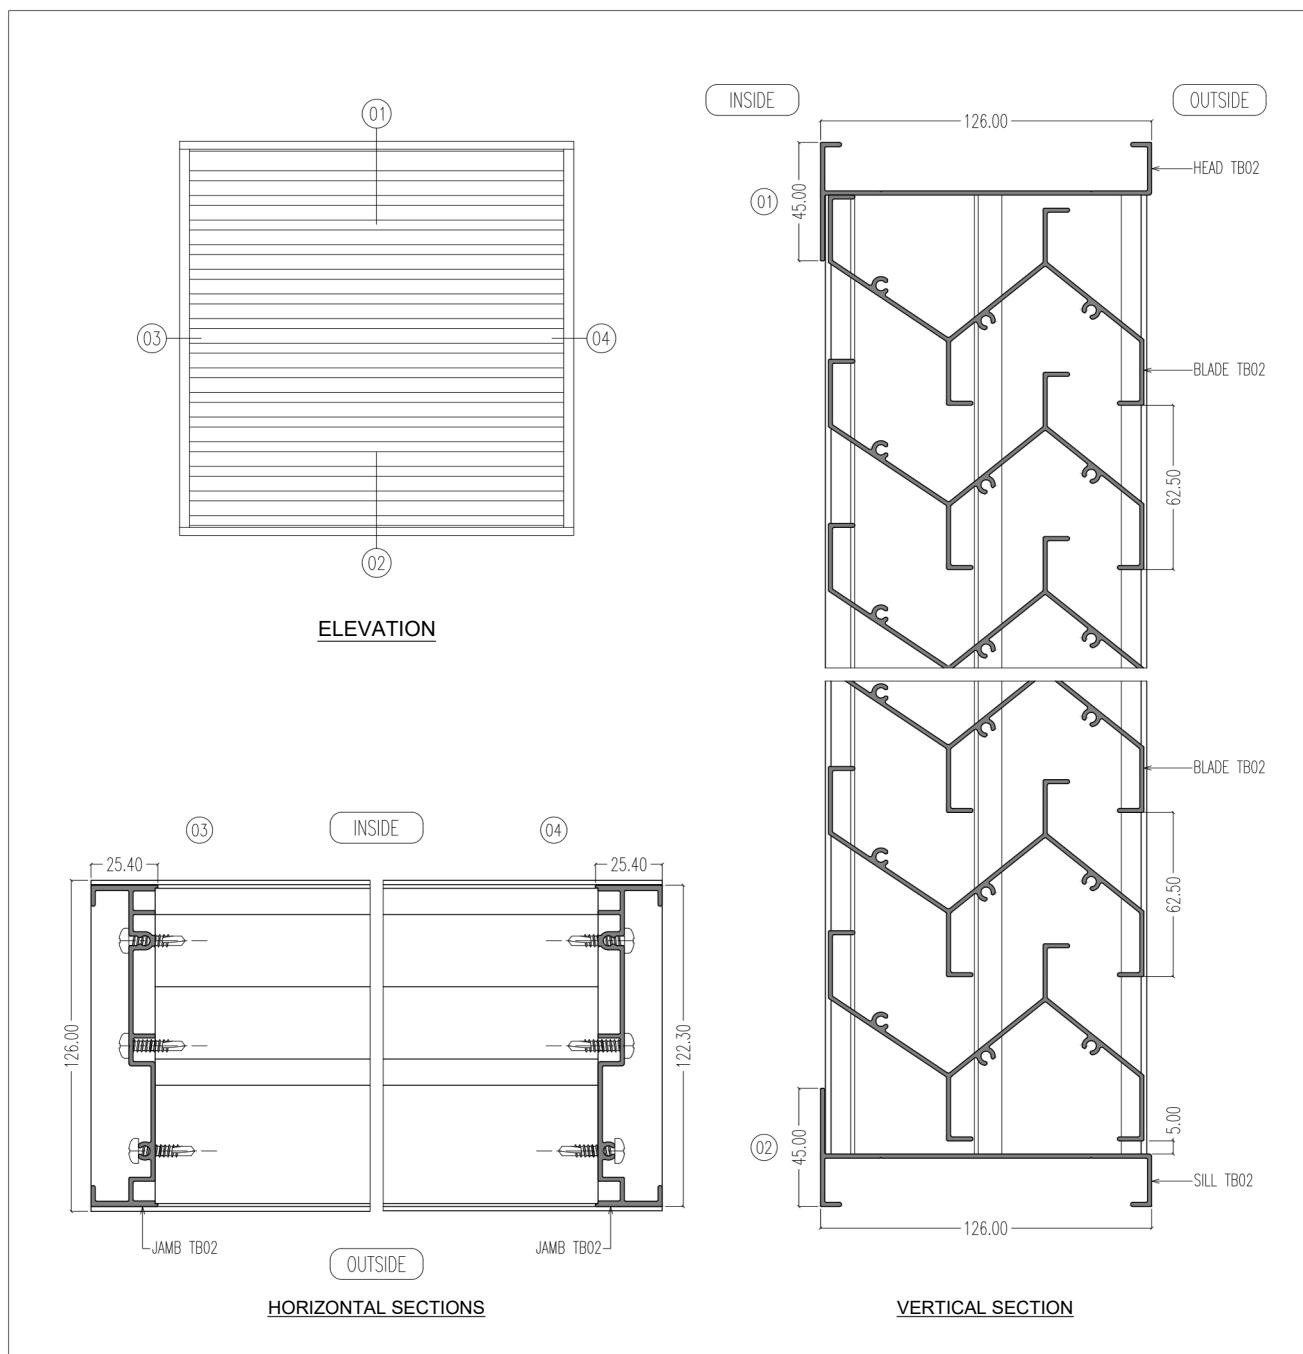



RAINWATER PENETRATION

Simulated Rainfall	75 (+10% / -0%)	mm/hr	Core Area Height	959	mm
Wind Speed	13 (+/-10%)	m/s	Core Area Width	942	mm
			Core Area Area	0.903	m ²

Ventilation Rate		Water Flow Rates		Effectiveness %	Class
Volume m ³ /s	Velocity m/s	Supply l/h	Penetrated l/h		
0.00	0.00	97.2	0.0	100.0	A
0.45	0.50	97.2	0.0	100.0	A
0.90	1.00	97.2	0.0	100.0	A
1.36	1.50	97.2	0.1	99.9	A
1.81	2.00	97.2	9.2	88.5	C
2.26	2.50	97.2	69.4	12.1	D
2.71	3.00	97.2	70.3	11.3	D
3.16	3.50	97.2	70.9	10.5	D

COEFFICIENT OF ENTRY

Air Temperature	25.4	°C	Core Area Height	959	mm
Barometer	1004.5	mbar	Core Area Width	942	mm
Air Density	1.167	kg/m ³	Core Area Area	0.903	m ²

Louvre p.d. Pa	Louvre Face Velocity	Air Flow Rate		Coefficient C _e
	m/s	Test m ³ /s	Theoretical m ³ /s	
23.6	0.63	0.568	5.744	0.099
90.2	1.25	1.126	11.230	0.100
160.0	1.66	1.498	14.956	0.100
240.0	2.04	1.841	18.318	0.101
320.0	2.35	2.122	21.152	0.100
399.0	2.62	2.371	23.619	0.100
480.0	2.89	2.608	25.905	0.101
560.0	3.12	2.820	27.981	0.101
641.0	3.35	3.023	29.936	0.101
724.0	3.56	3.212	31.815	0.101
Mean C _e				0.100
Class				4



COEFFICIENT OF DISCHARGE

Air Temperature	25.9	°C	Core Area Height	959	mm
Barometer	1004.1	mbar	Core Area Width	942	mm
Air Density	1.165	kg/m ³	Core Area Area	0.903	m ²

Louvre p.d. Pa	Louvre Face Velocity	Air Flow Rate		Coefficient C _d
	m/s	Test m ³ /s	Theoretical m ³ /s	
29.3	0.63	0.568	6.407	0.089
110.0	1.20	1.088	12.414	0.088
200.0	1.62	1.460	16.739	0.087
290.0	1.95	1.759	20.157	0.087
380.0	2.25	2.030	23.073	0.088
470.0	2.49	2.252	25.661	0.088
561.0	2.73	2.468	28.035	0.088
650.0	2.95	2.661	30.177	0.088
740.0	3.14	2.840	32.198	0.088
830.0	3.33	3.009	34.100	0.088
Mean C _d				0.088
Class				4

BRANCHES IN MALAYSIA

HQ Sales Office

(Gate A) Lot11, Jalan Perusahaan1
Kawasan Perusahaan Beranang
43700 Beranang
Selangor Darul Ehsan
Tel : +603-8725 8833 (Sales)
Fax : +603-8725 8826 (Sales)
+603-8725 8886 (Sales)

Johor Bahru

14&18, Lot PLO 206
Jalan Angkasa Mas 5
Kawasan Perindustrian Tebrau II
81100 Johor Bahru
Johor Darul Takzim
Tel : +607-355 0545
Fax : +607-355 0549

Melaka

Lot 90, Jalan IKS Malim Jaya 4
Taman Malim Jaya, 75250 Melaka
Tel : +606-337 3389
Fax : +606-337 2389

Penang

Lot24(PT1075), Tingkat Perusahaan 6
Kawasan Perusahaan Perai
13600 Perai, Pulau Pinang
Tel : +604-397 6998
+604-397 6995
Fax : +604-397 6997

Klang

Block 3-1-17, Jalan Nagasari A 36/A
Pusat Dagangan Latania
Desa Latania, Seksyen 36
40470 Shah Alam, Selangor Darul Ehsan
Tel : +603-5166 2239
+603-5166 5079
Fax : +603-5166 3829

Kuantan

No4, Jalan IM 3/6
Kawasan Perindustrian
Bandar Indera Mahkota
25200 Kuantan, Pahang Darul Makmur
Tel : +609-573 6666
Fax : +609-573 3322

Kota Kinabalu

Lot 7, Lorong Mangga 3
SEDCO Industrial Estate
5 1/2 Miles (Off Jalan Kolombong)
88450 Kota Kinabalu, Sabah
Tel : +6088-436 421
+6088-436 422
Fax : +6088-436 423

SUBSIDIARIES IN MALAYSIA

Albe Marketing Sdn. Bhd.

[199701031224 (446723-K)]
53 & 55, Jalan PBS 14/10
Taman Perindustrian Bukit Serdang
43300 Seri Kembangan
Selangor Darul Ehsan
Tel : +603-8945 4919
+603-8945 4920
+603-8945 4921
Fax : +603-8945 4916
Email : albemktg@lbalum.com.my

Albe Metal Sdn. Bhd.

[200101026250 (562008-A)]
Lot 2.46, Jalan Perindustrian Mahkota 2
Kawasan Perindustrian Mahkota
43700 Beranang, Selangor Darul Ehsan
Tel : +603-8726 1365
+603-8726 1083
Fax : +603-8723 8995
Email : albemetal@lbalum.com.my

LB Aluminium (Sarawak) Sdn. Bhd.

[200801009978 (811266-T)]
Lot 846 & 847, Block 7
Muara Tebas Land District (MTLD)
Jalan Demak Laut 3
Sejingkat Industrial Park
93050 Kuching, Sarawak
Tel : +6082-439 633
Fax : +6082-432 893

Facade Performance Lab Sdn. Bhd.

[201801033311 (1295338-T)]
Lot PT 20470, Jalan Perindustrian Mahkota 3/F
Taman Perindustrian Mahkota
43700 Beranang
Selangor Darul Ehsan
Tel : +603-8725 8936
Email : enquiry@fplab.com.my

SEMS Sdn. Bhd.

[199701035120 (450620-P)]
Lot No. 2.14, Jalan Perindustrian Mahkota 5
Kawasan Perindustrian Mahkota
43700 Beranang, Selangor Darul Ehsan
Tel : +6018-386 1493
+6018-989 1493
+6018-223 1493
+6018-289 1493
Email : sales@sems.com.my

SUBSIDIARY IN OVERSEAS

LB Aluminium (Singapore) Pte. Ltd.

(200009299G)
No 11, Kaki Bukit Road 1
#03-07 Eunos Technolink
Singapore 415939
Tel : +65-6345 9131
+65-6745 5693
Fax : +65-6745 5627

Our App is Available to Download



www.lbalum.com



**LB
ALUMINIUM
BERHAD**

198501006093 (138535-V)

HEAD OFFICE & FACTORY

Lot 11, Jalan Perusahaan1, Kawasan Perusahaan Beranang,
43700 Beranang, Selangor Darul Ehsan, Malaysia
Tel: +603-8725 8822 (Gen)
Fax: +603-8725 8828 (Gen), +603-8725 8866 (Export)
Email: enquiry@lbalum.com.my



CERTIFIED ISO 9001:2015 CERTIFIED ISO 14001:2015
CERT NO: QMS 00216 CERT NO: EMS 01118